

#### **DECLARATION OF PERFORMANCE**



No. 0008 - EN

1. Unique identification code of the product-type: fischer FIS GREEN

2. Intended use/es:

Product	Intended use/es
Metal injection anchors for use in masonry	For fixing and/or supporting to masonry, structural
	elements (which contributes to the stability of the works)
	or heavy units

3. Manufacturer: fischerwerke GmbH & Co. KG, Otto-Hahn-Straße 15, 79211 Denzlingen, Germany

4. Authorised representative: --

5. System/s of AVCP: 1

6a. Harmonised standard: ---

Notified body/ies: ---

6b. European Assessment Document: ETAG 029; 2013-04

European Technical Assessment: ETA-14/0471; 2015-02-03

Technical Assessment Body: DIBt

Notified body/ies: 1343 - MPA Darmstadt

7. Declared performance/s:

#### Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for tension and shear loads	See appendix, especially Annexes C 1 to C 3
Characteristic resistance for bending moments	See appendix, especially Annex C 4
Displacements under shear and tension loads	See appendix, especially Annex C 4
Reduction Factor for job site tests (β-Factor)	See appendix, especially Annex C 4
Edge distances and spacing	See appendix, especially Annex C 5

## Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorages satisfy requirements for Class A1
Resistance to fire	No performance determined (NPD)

8. Appropriate Technical Documentation and/or Specific Technical Documentation: ---

The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

Signed for and on behalf of the manufacturer by:

1.V. A. Dun

Andreas Bucher, Dipl.-Ing.

Wolfgang Hengesbach, Dipl.-Ing., Dipl.-Wirtsch.-Ing.

i.V. W. Myelal

Tumlingen, 2015-02-05

- This DoP has been prepared in different languages. In case there is a dispute on the interpretation the english version shall always prevail.

- The Appendix includes voluntary and complementary information in English language exceeding the (language-neutrally specified) legal requirements.

#### **Specific Part**

#### 1 Technical description of the product

The fischer injectionsystem FIS GREEN for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with fischer injection mortar, a perforated sieve sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod in the range of M6 to M16. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

# 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

#### 3 Performance of the product and references to the methods used for its assessment

### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for tension and shear loads	See Annex C 1 – C 3
Characteristic resistance for bending moments	See Annex C 4
Displacements under shear and tension loads	See Annex C 4
Reduction Factor for job site tests (β-Factor)	See Annex C 4
Edge distances and spacing	See Annex C 5

## 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorages satisfy requirements for Class A1
Resistance to fire	No performance determined (NPD)

#### 3.3 Hygiene, health and the environment (BWR 3)

Regarding dangerous substances there may be requirements (e.g. transposed European legislation and national laws, regulations and administrative provisions) applicable to the products falling within the scope of this European Technical Assessment. In order to meet the provisions of Regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.

## 3.4 Safety in use (BWR 4)

The essential characteristics regarding Safety in use are included under the Basic Works Requirement Mechanical resistance and stability.

#### 3.5 Protection against noise (BWR 5)

Not applicable.

### 3.6 Energy economy and heat retention (BWR 6)

Not applicable.

#### 3.7 Sustainable use of natural resources (BWR 7)

The sustainable use of natural resources was not investigated.

#### 3.8 General aspects

The verification of durability is part of testing the essential characteristics. Durability is only ensured if the specifications of intended use according to Annex B are taken into account.


# 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision of the Commission of 17 February 1997 (97/177/EC) (OJ L 073 of 14.03.97 p. 24-25), the system of assessment and verification of constancy of performance (see Annex V and Article 65 Paragraph 2 to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended use	Level or class	System
Metal injection anchors for use in masonry	For fixing and/or supporting to masonry, structural elements (which contributes to the stability of the works) or heavy units	_	1


## Installed conditions part 1

## Threaded rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

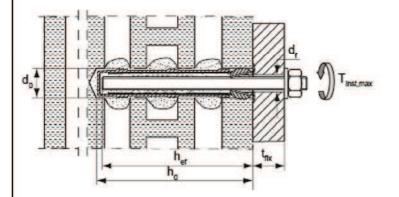


## Pre-positioned installation

FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K FIS H 20x200 K

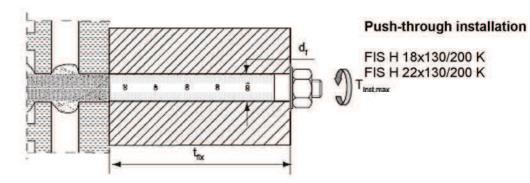

## Internal threaded anchors FIS E with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

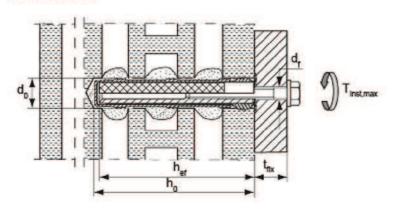

### Pre-positioned installation

FIS H 16x85 K - FIS E 11x85 FIS H 20x85 K - FIS E 15x85

h<sub>ef</sub> = effective anchorage depth

 $h_0$  = depth of drill hole

 $t_{fix}$  = thickness of fixture

 $d_0$  = nominal drill bit diameter  $d_f$  = diameter of clearance hole in the fixture

 $T_{inst,max}$  = maximum torque moment

## fischer Injectionsystem FIS GREEN for masonry

## **Product description**


Installed condition, part 1

Annex A 1


## Installed conditions part 2

Threaded rods without perforated sleeve FIS H K; Installation in solid brick masonry and aerated concrete


Pre-positioned installation

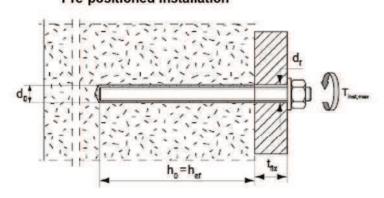

Push-through installation



Internal threaded anchors FIS E without perforated sleeve FIS H K; Installation in solid brick masonry and aerated concrete

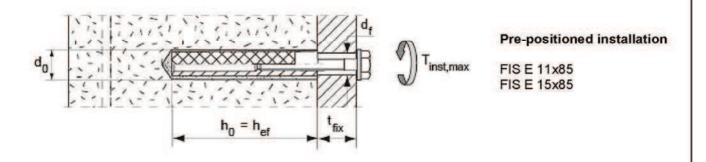

h<sub>ef</sub> = effective anchorage depth

 $h_0$  = depth of drill hole

 $t_{fix}$  = thickness of fixture

 $d_0$  = nominal drill bit diameter

 $d_f$  = diameter of clearance hole in the fixture

 $T_{inst,max}$  = maximum torque moment

fischer Injectionsy	stem FIS GREEN for	masonry
---------------------	--------------------	---------

Product description Installed condition, part 2 Annex A 2

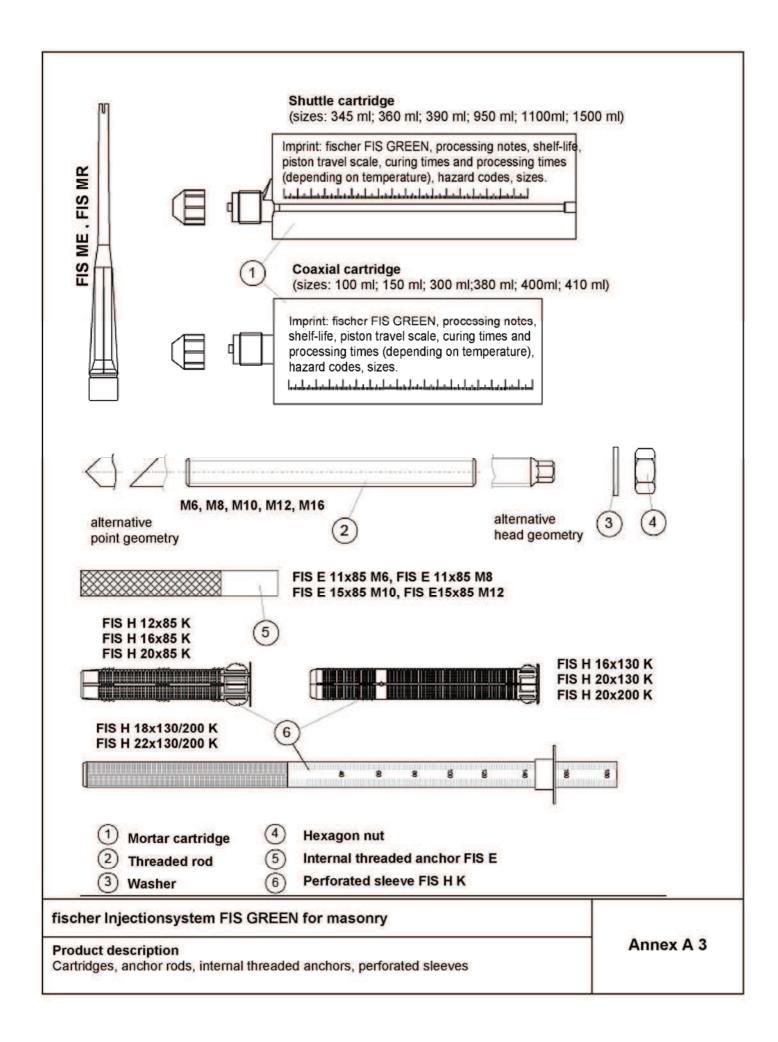


Table A1: Materials

Part	Designation	Material				
1	Mortar cartridge	Bio based mortar, hardener; fillers				
		Steel, zinc plated	Stainless steel A4	High corrosion- resistant steel c		
2	Threaded rod	Property class 5.8 or 8.8; ISO 898-1:2013 zinc plated $\geq$ 5 $\mu$ m, EN ISO 4042 A2K or hotdip galvanised EN ISO 10684:2004 $f_{uk} \leq$ 1000 N/mm <sup>2</sup> $A_5 > 8\%$	Property class 50, 70 or 80 EN ISO 3506:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062 EN 10088-1:2014 $f_{uk} \le 1000 \text{ N/mm}^2$ $A_5 > 8\%$	Property class 50 or 80 EN ISO 3506:2009 or property class 70 with $f_{yk}$ = 560 N/mm <sup>2</sup> 1.4565; 1.4529 EN 10088-1:2014 $f_{uk} \le 1000 \text{ N/mm}^2$ $A_5 > 8\%$		
3	Washer ISO 7089:2000	zinc plated ≥ 5μm, EN ISO 4042:1999 A2K or hot-dip galvanised ISO 10684:2004	1.4401; 1.4404; 1.4578;1.4571; 1.4439; 1.4362 EN 10088-1:2014	1.4565;1.4529 EN 10088-1:2014		
4	Hexagon nut	Property class 5 or 8; ISO 898-2:2013 zinc plated ≥ 5µm, ISO 4042:1999 A2K or hot-dip galvanised ISO 10684:2004	Property class 50, 70 or 80 ISO 3506:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4571; 1.4439; 1.4362 EN 10088-1:2014	Property class 50, 70 or 80 ISO 3506:2009 1.4565; 1.4529 EN 10088-1:2014		
5	Internal threaded anchor FIS E	Property class 5.8; ISO 898-1:2013 zinc plated ≥ 5µm, EN ISO 4042:1999 A2K	Property class 70 EN ISO 3506:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014		
6	Perforated sleeve FIS H K		PP / PE			

fischer Injectionsystem FIS GREEN for masonry	
Product description Materials	Annex A 4

#### Specifications of intended use

## Anchorages subject to:

Static and quasi-static loads

#### Base materials:

- Solid brick masonry (Use category b) and autoclaved aerated masonry (Use category d), acc. to Annex B 7. Note: The characteristic resistance is also valid for larger brick sizes and higher compressive strength of the masonry unit.
- Hollow brick masonry (use category c), according to Annex B 7.
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010.
- For other bricks in solid masonry and in hollow or perforated masonry, the characteristic resistance of the anchor may be determined by job site tests according to ETAG 029, Annex B under consideration of the β-factor according to Annex C 4, Table C4.

#### **Temperature Range:**

From - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)

#### **Use conditions (Environmental conditions):**

- Dry and wet structure (regarding injection mortar).
- Structures subject to dry internal conditions (zinc coated steel, stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure including industrial and marine environment (stainless steel or high corrosion resistant steel).
- Structures subject to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other
  particular aggressive conditions (high corrosion resistant steel)
   Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of
  seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in
  desulphurization plants or road tunnels where de-icing materials are used).

#### Design:

- The anchorages have to be designed in accordance with the ETAG 029, Annex C, Design method A under the responsibility of an engineer experienced in anchorages and masonry work.
- Verifiable calculation notes and drawings have to be prepared taking account the relevant masonry in the
  region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The
  position of the anchor is indicated on the design drawings.

#### Installation:


- Dry or wet structures (use category d/d and use category w/w).
- · Hole drilling by hammer drill mode.
- · In case of aborted hole: The hole shall be filled with mortar
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Fastening screws or threaded rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E
- min. curing time see table B3
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:

material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A4, Table A1

conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored.

marking of the threaded rod with the envisage embedment depth. This may be done by the manufacturer of the rod or by a person on job site.

fischer Injectionsystem FIS GREEN for masonry	
Intended Use Specifications	Annex B 1

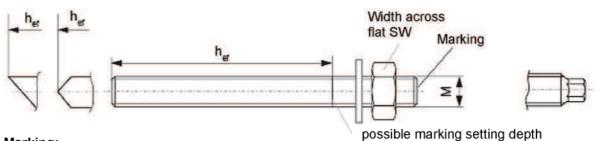

Marking:

Property class 8.8 or high corrosion-resistant steel C, property class 80: •

Stainless steel A4, property class 50 and high corrosion-resistant steel C, property class 50: ••

Table B1.1: Installation parameters (threaded rod without perforated sleeve)

Size				M6	M8	M10	M12	M16
Nominal drill hole diar	neter	$d_{nom}=d_0$	[mm]	8	10	12	14	18
Width across flat		SW	[mm]	10	13	17	19	24
Effective anchorage d	lepth <sup>1)</sup>	h <sub>ef,min</sub>	[mm]		50 100			100
Depth of drill hole ho =	= h <sub>ef</sub>	h <sub>ef,max</sub>	[mm]	200				
Maximum torque mon	nent	T <sub>inst,max</sub>	[Nm]	4 10				
Max. torque moment	for aerated concrete	T <sub>inst,max</sub>	[Nm]	1	1 2 4			
Diameter of clearance	Pre-position anchorage	d <sub>f</sub> ≤	[mm]	7	9	12 14 18		18
hole in the fixture	Push through anchorage	d <sub>f</sub> ≤	[mm]	9	11	14	16	20

<sup>&</sup>lt;sup>1)</sup>  $h_{ef,min} \le h_{ef} \le h_{ef,max}$  is possible.

# fischer internal threaded anchor FIS E

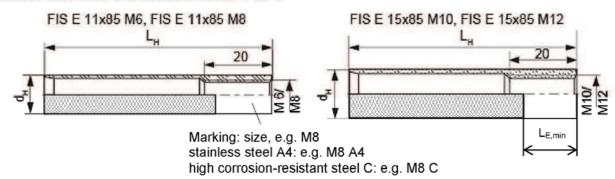



Table B1.2: Installation parameters (internal threaded anchor FIS E without perforated sleeve)

Size FIS E			11x85 M6	11x85 M8	15x85 M10	15x85 M12	
Nominal drill hole diameter	$d_{nom}=d_0$	[mm]		14 18			
Depth of drill hole	h <sub>0</sub>	[mm]			90		
Effective anchorage depth	L <sub>H</sub> =h <sub>ef</sub>	[mm]		85			
Maximum torque moment	T <sub>inst, max</sub>	[mm]	4 10				
Max. torque moment for aerated concrete	T <sub>inst, max</sub>	[mm]	4				
Diameter of clearance hole in the fixture	d <sub>f</sub> ≤	[mm]	7 9 12 14				
Screw-in depth	$L_{E,min}$	[mm]	6	8	10	12	

fischer Injectionsystem FIS GREEN for masonry	
Intended Use Installation parameters, part 1	Annex B 2

# Perforated sleeves FIS H 12x85; 16x85; 16x130; 20x85; 20x130; 20x200 K








Table B1.3: Installation parameters (threaded rod and internal threaded anchor with perforated sleeve; only pre-positioned anchorage)

Size FIS HK			12x85	16x85	16x130	20x85	20x130	20x200
Nominal drill hole diameter (d <sub>0</sub> = D <sub>Steeve</sub> )	d <sub>nom</sub> =d <sub>0</sub>	[mm]	12	16		20		
Depth of drill hole	h <sub>o</sub>	[mm]	90	90	135	90	135	205
Effective anchorage depth <sup>1)</sup>	h <sub>ef,min</sub>	[mm]	85	85	110	85	110	180
Lifective affortionage depth	h <sub>ef,max</sub>	[mm]	85	85	130	85	130	200
Size of threaded rod		[-]	M6, M8	M8, M10		M12, M16	M12, M16	
Size of internal threaded anchor		[-]		11x85		15x85		
Maximum torque moment threaded rod and internal threaded anchor	T <sub>inst,max</sub>	[mm]	2	4				

<sup>1)</sup>  $h_{ef,min} \le h_{ef} \le h_{ef,max}$  is possible.

## Perforated sleeves FIS H 18x130/200 K and FIS H 22x130/200 K




Table B1.4: Installation parameters (threaded rod with perforated sleeve; push-through anchorage)

Size FIS HK			18x130/200	22x130/200	
Nominal drill hole diameter ( $d_0 = D_{Sleeve}$ )	Nominal drill hole diameter ( $d_0 = D_{Sleeve}$ ) $d_{nom} = d_0 [mm]$ 18			22	
Depth of drill hole	h <sub>o</sub>	[mm]	135 + t <sub>fix</sub>		
Effective anchorage depth	h <sub>ef,min</sub>	[mm]	130		
Size of threaded rod		[-]	M10 or M12 M16		
Maximum torque moment threaded rod	T <sub>inst,max</sub>	[Nm]	4		
Diameter of clearance hole in the fixture	d₁≤	[mm]	18 22		
Thickness of fixture	t <sub>fix,max</sub>	[mm]	200		

fischer Injectionsystem FIS GREEN for masonry	
Intended Use Installation parameters, part 2.	Annex B 3

# Steel brush BS



Only for solid bricks and aerated concrete

Table B2: Parameters of steel brush

Drill hole diameter	$d_0$	[mm]	8	10	12	14	16	18	20	22
Brush diameter	d <sub>b,</sub>	[mm]	9	11	14	16	20	20	25	25

**Table B3:** Maximum processing time of the mortar and minimum curing time (During the curing time of the mortar the masonry temperature may not fall below the listed minimum temperature).

Temperature at			Minimum curing time 1)
anchoring base			$t_cure$
[°C]			[minutes]
>±0	to	+5	6 hours
>+5	to	+10	4 hours
>+10	to	+20	90
>+20	to	+30	60
>+30	to	+40	30


System-	Maximum processing
temperature	time t <sub>work</sub>
(mortar) [ °C ]	[minutes]
+5	13
+10	9
+20	5
+30	4
+40	2

 $<sup>^{\</sup>rm 1)}\,{\rm For}$  wet masonry the curing time must be doubled.


fischer Injectionsystem FIS GREEN for masonry	
Intended Use	Annex B 4
Steel brush	
Processing times and curing times	

#### Installation instructions

### Preparing the cartridge

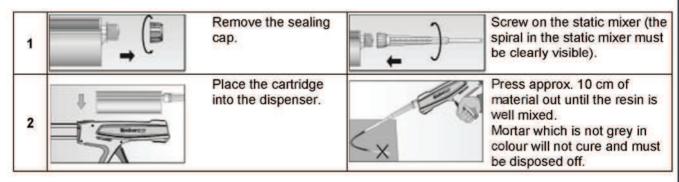

## Installation in solid brick and aerated concrete (without perforated sleeve)

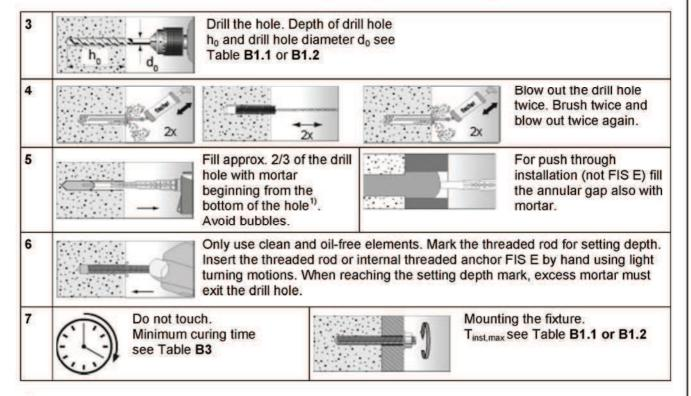


<sup>1)</sup> For the exact quantity of mortar see manufacturer's spezification.

fischer Injectionsystem FIS GREEN for masonry	
Intended Use Installation instructions part 1	Annex B 5

#### Installation in perforated or solid brick with perforated sleeve (pre-positioned anchorage) Drill the hole (hammer drill). When installing the perforated Depth of drill hole ho and drill sleeve in solid bricks or solid areas of hollow bricks, also clean the hole hole diameter do see Table by blowing and brushing. B1.3 4 Insert the Fill the perforated perforated sleeve sleeve completely flush with the with mortar beginning from the bottom of the surface of the hole.1) masonry or plaster. Insert the anchor rod or internal threaded 5 anchor FIS E by hand using light turning motions till reaching the setting depth mark (= length of perforated sleeve) 6 Tighten the hexagon Do not touch. Minimum curing time see Table B3 T<sub>inst,max</sub> see Table

B1.3


For the exact quantity of mortar see manufacturer's spezification.

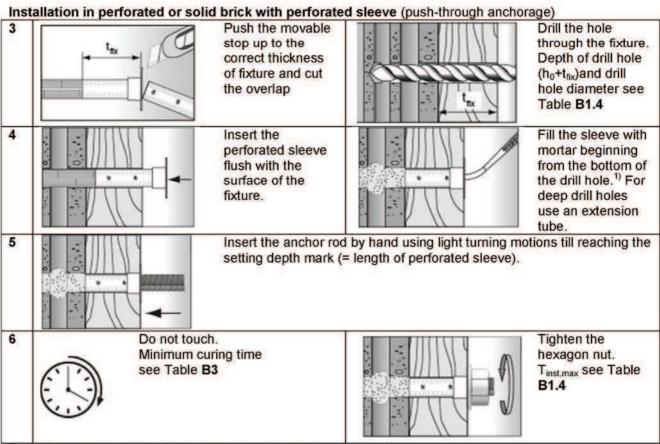

For the exact quantity of mortar see manufacturer's spezification.


fischer Injectionsystem FIS GREEN for masonry	
Intended Use Installation instructions part 2	Annex B 6

Brick No. 1 Solid brick Mz acc. to EN 771-2 p≥ 1,8 [kg/dm³] fb ≥ 10 or 20 [N/mm²]




Brick No. 6
Sand-lime hollow brick
acc. to EN 771-2
p≥ 1,4 [kg/dm³]
fb ≥ 12 or 20 [N/mm²]

Brick No. 2 Solid sand-lime brick acc. to EN 771-2  $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb  $\ge 10 \text{ or } 20 \text{ [N/mm}^2\text{]}$ 



Brick No. 7
Perforated brick HLz
filled with mineral wool
acc. to EN 771-1
p ≥ 0,6 [kg/dm³]
fb ≥ 8 [N/mm²]

Brick No. 3 Solid sand-lime brick acc. to EN 771-2 p ≥ 1,8 [kg/dm³] fb ≥ 10 or 20 [N/mm²]



Brick No. 8


Perforated brick HLz

acc. to EN 771-1


ρ≥ 0,9 [kg/dm³]


fb≥ 10 [N/mm²]


Brick No. 4 Solid brick Mz acc. to EN 771-2  $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb  $\ge 20 \text{ [N/mm}^2\text{]}$ 



Brick No. 9 Aerated concrete block  $\rho \ge 350$  or 500 or 650 [kg/dm<sup>3</sup>] fb  $\ge 2$  or 4 or 6 [N/mm<sup>2</sup>]







# fischer Injectionsystem FIS GREEN for masonry

### Intended Use

Types and dimensions of blocks and bricks

Annex B 7

Table B4.1: Allocation of anchor rods<sup>1)</sup>, perforated sleeves<sup>1)</sup> and bricks Valid anchor rods and perforated sleeves **Bricks** No.1 M6; M8; M10; M12 FIS E 11x85 FIS E 15x85 No.2 M6; M8; M10; M12 FIS E 11x85 FIS E 15x85 FIS H 12x85 K; FIS H 16x85 K; No.3 FIS H 20x85 K; FIS H 16x130K; FIS H 20x130 K FIS H 22x130/200K FIS H 18x130/200K, No.4 M6; M8; M10; M12 FIS E 11x85 FIS E 15x85 No.5 FIS H 12x85 K; FIS H 16x85 K; FIS H 20x85 K No.6 FIS H 12x85 K; FIS H 16x85 K; FIS H 20x85 K; FIS H 16x130K; FIS H 20x130 K

 $<sup>^{1)}</sup>$  Other combinations can be used after job site tests acc. to ETAG 029, Annex B. The  $\beta$ - factor for this job site tests are given in Table C4

fischer Injectionsystem FIS GREEN for masonry	
Intended Use Allocation of anchor rods, perforated sleeves and bricks, part 1	Annex B 8

FIS H 18x130/200K, FIS H 22x130/200K

Valid anchor rods and perforated sleeves **Bricks** FIS H 12x85 K; FIS H 16x85 K; No.7 FIS H 20x85 K; FIS H 16x130K; FIS H 20x130 K; FIS H 20x200 K FIS H 18x130/200K, FIS H 22x130/200K No.8 FIS H 12x85 K; FIS H 16x85 K; FIS H 20x85 K; FIS H 16x130K; FIS H 20x130 K FIS H 18x130/200K, FIS H 22x130/200K No.9 M6;M8; M10; M12; M16 FIS E 11x85; FIS E 15x85

Table B4.2: Allocation of anchor rods<sup>1)</sup>, perforated sleeves<sup>1)</sup> and bricks

fischer Injectionsystem FIS GREEN for masonry	
Intended Use Allocation of anchor rods, perforated sleeves and bricks, part 2	Annex B 9

 $<sup>^{1)}</sup>$  Other combinations can be used after job site tests acc. to ETAG 029, Annex B. The  $\beta$ - factor for this job site tests are given in Table C4

Table C1.1: Characteristic values of resistance to tension loads and to shear loads for solid bricks

	Doneity o			1	ective iorage	(	Characteristic resist [kN]			tance	
	Density ρ [kg/dm³]		Anchor size or	1	epth		N <sub>Rk</sub>		<u>"]</u>	V <sub>Rk</sub> <sup>2)</sup>	
Brick	Compressive strength f <sub>b</sub>	Sleeve	screw size in internal threaded hermin hermax		Ter 24/4		Ter 50/8	mp. 80°C	All		
No.	[N/mm <sup>2</sup> ]	FIS HK	anchor	h <sub>ef,min</sub> [mm]	h <sub>ef,max</sub> [mm]	d/d	w/w	d/d	w/w	categorie	
			M6	50	85	1,5 (1,5)	0,9 (0,9)	1,5 (1,5)	0,9 (0,9)	4,0	
			M8	50	200	2,5 (2,5)	2,5 (2,5)	2,5 (2,5)	2,5 (2,5)	(2,5)	
115			M10	50	79	4,5	(3,0)	4,5	(3,0)	6,0	
1	ρ≥1,8		M10	80	199	6,0	(4,5)	6,0	(4,5)	(4,0)	
	$f_b \ge 20$ $(f_b \ge 10)$	without	M10	200	200	12,0	(11,0)	12,0	(11,0)	12,0 (8,5	
340	(Ib = 10)		M12	50	79	4,0	(3,0)	4,0	(3,0)	5 5 (4 O)	
1			M12	80	199	7,0(	5,0)	7,0	(5,0)	5,5 (4,0)	
			M12	200	200	10,0	(7,0)	10,0	(7,0)	12,0 (11,	
			FIS E M6/8, FIS E M10/M12	85	85	6,0 (4,5)		6,0 (4,5)		4,0 (2,5)	
		≥ 20 without	M6	50	85	1.5 (1,5)	0.9 (0,9)	1.5 (1,5)	0.9 (0,9)	4,0 (3,0)	
115			M8	50	200	2,5			(2,5)		
			M10	50	79	3,0		3,0		5,5 (4,0)	
	ρ ≥ 1,8		M10	80	199	4,0		4,0		3,5 (4,0	
			M10	200	200	12,0	(9,0)	12,0	(9,0)		
240	(f <sub>b</sub> ≥ 10)		M12	50	79	3,0	4-101010-00		(2,0)	7,0 (5,0)	
			M12	80	199	4,5		4,5	-		
2			M12 FIS E M6/8, FIS E M10/M12	200 85	200 85	4,0	(9,0)	12,0 (9,0) 4,0 (2,5)		4,0 (3,0)	
1110		12x85	M6/8	85	85	8,0	(5,5)	4,5	(3,0)	4,5 (3,0)	
1		16x85	M8/M10	85	85	4,5	(3,5)	3,0	(2,0)		
.9.	ρ ≥ 1,8	20x85	M12/M16	85	85	12,0		-7%	(5,5)		
110	(f <sub>b</sub> ≥ 10)	f <sub>b</sub> ≥ 20	M8/M10 M10/M12	110	130	4,5 (3,0) 2,5 (2		and the second	5,5 (3,5)		
3		20x130 22x130/200	M12/M16 M16	110	130	8,5	(6,0)	5,0	(3,5)	1	
109			M6	50	200	1,5	0,9	1,5	0,9	2,5	
3	ρ ≥ 1,8	without	M8	50	200	2	0	2	,0	4,0	
	f <sub>b</sub> ≥ 20	without	M10	50	200	2	0	2	,0	199000	
4	AND THE PARTY OF		M12	50	200	3	0	3	,0	5,5	

 $<sup>^{1)}</sup>$  For design according to ETAG 029, Annex C: N<sub>Rk</sub> = N<sub>Rk,p</sub> = N<sub>Rk,b</sub> = N<sub>Rk,s</sub>  $^{2)}$  For design according to ETAG 029, Annex C: V<sub>Rk</sub> = V<sub>Rk,c</sub> = V<sub>Rk,c</sub> = V<sub>Rk,c</sub>

fischer Injectionsystem FIS GREEN for masonry	
Performances Characteristic values of resistance to tension load and shear load, part 1	Annex C 1

Table C1.2:	Characteristic values of resistance to tension loads and to shear loads for
	nerforated bricks

perfo	rated bricks	6						
	Doneity o			1	ctive ge depth	Character	ince [kN]	
	Density ρ [kg/dm³]					$N_R$	$V_{Rk}^{2)}$	
Brick	- Compressive	Sleeve	Anchor size or screw size in		h	Temp. 24/40°C	Temp. 50/80°C	All catego-
Brick No.	strength f <sub>b</sub> [N/mm <sup>2</sup> ]	FIS HK	internal threaded anchor	h <sub>ef,min</sub> [mm]	h <sub>ef,max</sub> [mm]	d/d w/w	d/d w/w	ries
5	ρ ≥ 1,4 f <sub>b</sub> ≥ 8	12x85 16x85 20x85	M6/M8 M8/M10 M12/M16	85	85	3,5	2,0	2,5
		12x85	M6/M8	85	85	3,5 (2,0)	2,0 (1,2)	4,5 (2,5)
715	ρ ≥ 1,4	16x85	M8/M10	85	85			8,0 (5,5)
	$f_b \ge 20$ $(f_b \ge 12)$	20x85	M10, M12/M16,	85	85	5,5 (3,5)	3,5 (2,0)	7,5 (4,5)
340		16x130 18x130/200	M8/M10 M10/M12	110	130			8,0 (5,5)
		20x130 22x130/200	M12/M16 M16	110	130	4,5 (2,5)	2,5 (1,5)	7,5 (4,5)
		12x85	M6/M8	85	85	2	1,2	2,5
50	ρ ≥ 0,6	16x85	M8/M10	85	85	1,5	0,9	3,0
		20x85	M12,M16	85	85	2,0	1,2	1,5
372	f <sub>b</sub> ≥ 8	16x130 18x130/200	M8/M10 M10/M12	130	130	2,5	1,5	3,0
7	20x130 M12/M16 110 130	130	2,0	1,2	1,5			
		20x200	M12/M16	180	200	2,5	1,5	1,5
		12x85	M6, M8	85	85	3,5	2,0	4,0
15		16x85	M8,M10	85	85	3,5	2,0	3,0 1,5 1,5 4,0 5,5
5 (11)	ρ ≥ 0,9	20x85	M12, M16	85	85	4,0	2,5	6,0
6	f <sub>b</sub> ≥ 10	16x130 18x130/200	M8/M10 M10/M12	110	130	4,5	2,5	5,5
240		20x130 22x130/200	M12/M16 M16	110	130	3,5	2,0	6,0

The strict of t

fischer Injectionsystem FIS GREEN for masonry	
Performances Characteristic values of resistance to tension load and shear load, part 2	Annex C 2

Table C1.3: Characteristic values of resistance to tension loads and shear loads for aerated concrete

				Effective anchorage depth		Cha	racter	ance [kN]		
	Density ρ [kg/dm³]						N <sub>R</sub>	1) !k		$V_{Rk}^{2)}$
Deiele	- Compressive	Olassia	Anchor size or screw size in	L	L		mp. 10°C	Te: 50/8	mp. 30°C	All catego-
Brick No.	strength f <sub>b</sub> [N/mm <sup>2</sup> ]	Sleeve FIS HK	internal threaded anchor	h <sub>ef,min</sub> [mm]	h <sub>ef,max</sub> [mm]	d/d	w/w	d/d	w/w	ries
			M6	100	200	1,5	1,2	1,5	1,2	
			M8	100	200	2,0	1,5	2,0	1,5	0,9
	ρ ≥ 350 f <sub>b</sub> ≥ 2	without	M10	100	200	2,0	1,5	2,0	1,5	0,9
	25,000		M12	100	200	2,5	2,0	2,5	2,0	
			M16	100	200	2,5	2,0	2,5	2,0	1,2
175	ρ ≥ 500 f <sub>b</sub> ≥ 4	without	M6	100	200	2,0	1,5	2,0	1,5	1,5
2			M8	100	200	2,5	2,0	2,5	2,0	
			M10	100	200	3,0	2,0	3,0	2,0	
			M12	100	200	3,0	2,5	3,0	2,5	
9			M16	100	200	3,0	2,5	3,0	2,5	
			M6	100	200	2,5	2,0	2,5	2,0	
			M8	100	200	3,5	2,5	3,5	2,5	2,5
	ρ ≥ 650 f <sub>b</sub> ≥ 6	without	M10	100	200	4,0	3,0	4,0	3,0	
	- 5		M12	100	200	4,0	3,0	4,0	3,0	
			M16	100	200	4,0	3,0	4,0	3,0	2,0

 $<sup>^{1)}</sup>$  For design according to ETAG 029, Annex C:  $N_{Rk}$  =  $N_{Rk,p}$  =  $N_{Rk,b}$  =  $N_{Rk,s}$   $^{2)}$  For design according to ETAG 029, Annex C:  $V_{Rk}$  =  $V_{Rk,b}$  =  $V_{Rk,c}$  =  $V_{Rk,s}$ 

fischer Injectionsystem FIS GREEN for masonry	
Performances Characteristic values of resistance to tension loads and shear loads for aerated concrete, part 3	Annex C 3

**Table C2: Characteristic bending moments** 

Size					M6	M8	M10	M12	M16
	Zinc-plated	Property	5.8	[Nm]	8	19	37	65	166
Charac-	steel	class	8.8	[Nm]	12	30	60	105	266
teristic	Stainless	Property	50	[Nm]	8	19	37	65	166
bending	ding steel A4	class	70	[Nm]	11	26	52	92	232
moment	High corrosion- Prope resistant cla steel C	Droporty	50	[Nm]	8	19	37	65	166
$M_{Rk,s}$		class	70 <sup>1)</sup>	[Nm]	11	26	52	92	232
		UI 033	80	[Nm]	12	30	60	105	266

 $<sup>^{1)}</sup> f_{uk} = 700 \text{ N/mm}^2; f_{yk} = 560 \text{ N/mm}^2$ 

Table C3: Displacements under tension load and shear load

	N	$\delta_{\text{N0}}$	$\delta_{\text{N}\infty}$
	[kN]	[mm]	[mm]
Solid bricks <sup>1)</sup>	$N_{Rk}$	1,32	2,64
Perforated bricks <sup>2)</sup>		1,0	2,0
Aerated concrete	$1,4*\gamma_M$	1,0	2,0

V	$\delta_{V0}$	$\delta_{V_{\infty}}$
[kN]	[mm]	[mm]
$V_{Rk}$	1,2	1,8
	1,9	2,85
$1,4 * \gamma_M$	2,93	4,4

Table C4: β- factor for job site tests according to ETAG 029, Annex B


Brick	Size	β- Factor					
No.		Temp 2	4°C/40°C	Temp 50°C/80°C			
		d/d	w/w	d/d	w/w		
	M6;M8	0,8	0,48	0,80	0,48		
1	M12x200	0,78	0,78	0,78	0,78		
	Other sizes	0,84	0,84	0,84	0,84		
	Other sizes	0,84	0,84	0,81	0,81		
2	M8x200	0,55	0,55	0,55	0,54		
	M6x50	0,84	0,51	0,84	0,51		
3	All sizes	0,84	0,84	0,51	0,5		
4	Other sizes	0,84	0,84	0,84	0,84		
4	M6x50	0,84	0,51	0,84	0,51		
5	All sizes	0,71	0,71	0,43	0,43		
6	All sizes	0,84	0,84	0,51	0,50		
7	Other sizes	0,84	0,84	0,51	0,51		
	20x130,20x200	0,67	0,67	0,41	0,4		
8	All sizes	0,84	0,84	0,51	0,50		
9	All sizes	1,0	0,79	1,0	0,79		

fischer Injectionsystem FIS GREEN for masonry	
Performances Characteristic bending moments; displacements; β- factors for job site tests	Annex C 4

<sup>&</sup>lt;sup>1)</sup> Brick No.: 1; 2; 3; 4 <sup>2)</sup> Brick No.: 5; 6; 7; 8

Table C5: Edge distance and spacing (installation with and without sleeves)

Direction to bed joint							Min.
Brick No.	h <sub>ef</sub> [mm]	C <sub>min</sub>	S <sub>min</sub>	S <sub>cr</sub>	S <sub>min</sub>	S <sub>cr</sub>	thickness of the masonry members
		[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
1, 2	50	100	150		150		
	80	100	240		240		
	200	150	300		300		
3	85	100	255		255		(00
	130	100	390		390		3
4	50	100	150		150		30 (
5	all sizes	100	55		230		h <sub>ef</sub> + 30 (≥ 80)
6	all sizes	100	115		240		hef
7	all sizes	120	240		250		
8	all sizes	120	115		240		
9	all sizes	80	115		240		

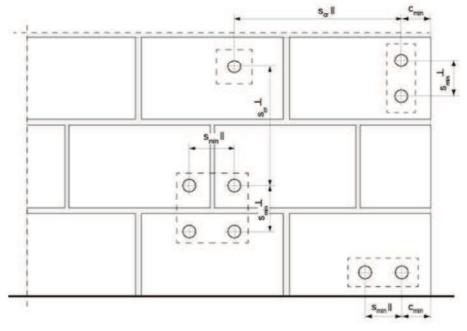

 $s_{\text{min}}\, \|$  = Minimum spacing anchor group parallel to bed joint

 $s_{min}^{\perp}$  = Minimum spacing anchor group vertical to bed joint

 $\mathbf{s}_{cr} \|_{\mathbf{r}} = \mathbf{Characteristic}$  spacing anchor group parallel to bed joint

 $s_{cr}^{\perp}$  = Characteristic spacing anchor group vertical to bed joint

 $c_{cr} = c_{min} = Edge distance$ 

group of 2 anchors:  $N_{Rk}^g$ =2x  $N_{Rk}$ ;  $V_{Rk}^g$ =2x  $V_{Rk}$  group of 4 anchors:  $N_{Rk}^g$ =4x  $N_{Rk}$ ;  $V_{Rk}^g$ =4x  $V_{Rk}$ 

fischer Injectionsystem FIS GREEN for masonry	
Performances Edge distance and spacing	Annex C 5